

AUSTRALIAN INSTALLATION GUIDE


Installation in accordance with AS/NZS 3500.1 and AS/NZS 3500.2.

Culligan units must be installed according to the local guidelines. Culligan units should only be connected to a potable drinking water supply. Culligan units should not be connected to water supplies of unknown bacterial quality or those not already fit for human consumption.

Culligan International strongly recommends the use of an anti-flood device.

Installation Instructions and parts required

1. K001 Install kit as below, (1 x 63058/103988 – brass tee, 1 x 54011/104115 ball valve, 1 x 52028/104177 dual check valve)

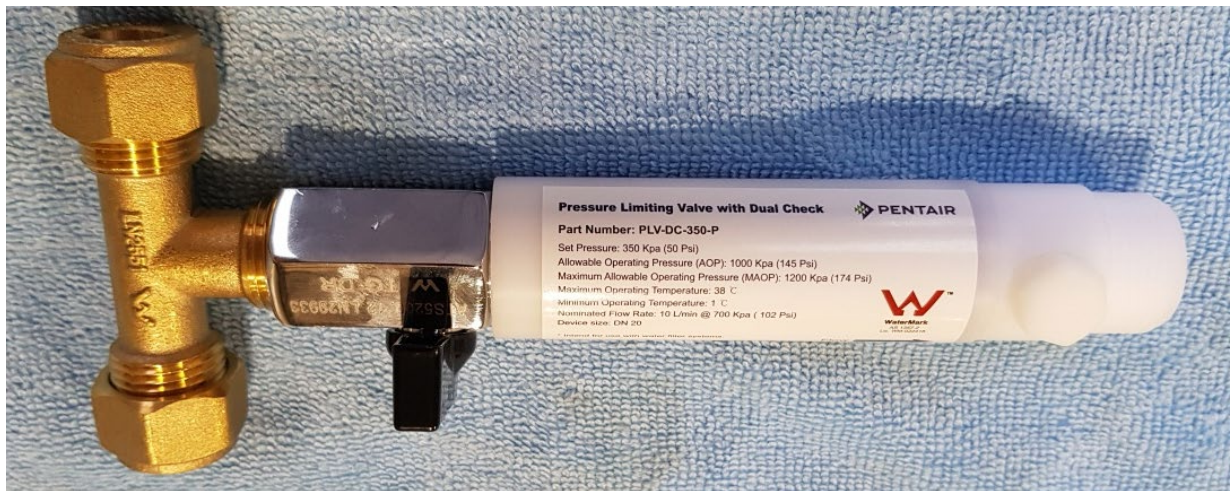

2. Serialised Unit
3. Diamond Flow Filter and Head

Options to above PLV

RMC PVDC50 dual check valve – 350 kpa PLV code 52010 / 100665

Accessories

1. JG ¼ sf x 3/8 stem elbow x 2 (for filter head) 60157 / 100963
2. JG ¼ sf x ¼ npt tap adaptor 60175 / 104065
3. Waterblock 50000 / 101084
4. JG ¼ sf x ¼ sf isolating valve 60127 / 100932
5. JG ¼ tube (black only) x 5 meters 60800 / 104105 roll
6. JG ¼ locking clips x 5 60124 / 104162

Any installation that requires us to run water \geq 5M to our unit, must be using AUSPEX or a Watermark equivalent product for all tubing runs. For our compliance the product we use to run the water from the source to our unit must be Watermarked.

After hours sales/service – 1300 88 14 14